



**UWL REPOSITORY**  
**repository.uwl.ac.uk**

Comparing building performance of supermarkets under future climate change: UK case study

Hasan, Agha ORCID: <https://orcid.org/0000-0002-7345-6418>, Bahadori-Jahromi, Ali ORCID: <https://orcid.org/0000-0003-0405-7146>, Mylona, Anastasia, Ferri, Marco and Zhang, Hexin (2022) Comparing building performance of supermarkets under future climate change: UK case study. *Advances in Energy Research*, 8 (1). pp. 73-93. ISSN 2287-6316

10.12989/eri.2022.8.1.073

This is the Accepted Version of the final output.

UWL repository link: <https://repository.uwl.ac.uk/id/eprint/8581/>

**Alternative formats:** If you require this document in an alternative format, please contact: [open.research@uwl.ac.uk](mailto:open.research@uwl.ac.uk)

**Copyright:**

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

**Take down policy:** If you believe that this document breaches copyright, please contact us at [open.research@uwl.ac.uk](mailto:open.research@uwl.ac.uk) providing details, and we will remove access to the work immediately and investigate your claim.

## Comparing building performance of supermarkets under future climate change: UK case study

Agha Usama Hasan <sup>1a</sup>, Ali Bahadori-Jahromi<sup>\*1</sup>,  
Anastasia Mylona <sup>2</sup>, Marco Ferri <sup>3</sup> and Hexin Zhang <sup>4</sup>

<sup>1</sup> Department of Civil Engineering and Built Environment, School of Computing and Engineering, University of West London, W5 5RF, London, UK

<sup>2</sup> Research Department, The Chartered Institution of Building Services Engineers (CIBSE), SW12 9BS, London, UK

<sup>3</sup> LIDL Great Britain Ltd., 19 Worple Road, SW19 4JS, London, UK

<sup>4</sup> School of Engineering and the Built Environment, Edinburgh Napier University, 10 Clinton Road, Edinburgh Scotland, EH10 5DT, UK

(Received June 25, 2021, Revised December 8, 2021, Accepted January 13, 2022)

**Abstract.** Focus on climate change and extreme weather conditions has received considerable attention in recent years. Civil engineers are now focusing on designing buildings that are more eco-friendly in the face of climate change. This paper describes the research conducted to assess the impact of future climate change on energy usage and carbon emissions in a typical supermarket at multiple locations across the UK. Locations that were included in the study were London, Manchester, and Southampton. These three cities were compared against their building performance based on their respective climatic conditions. Based on the UK Climatic Projections (UKCP09), a series of energy modelling simulations which were provided by the Chartered Institute of Building Service Engineers (CIBSE) were conducted on future weather years for this investigation. This investigation ascertains and quantifies the annual energy consumption, carbon emissions, cooling, and heating demand of the selected supermarkets at the three locations under various climatic projections and emission scenarios, which further validates annual temperature rise as a result of climatic variation. The data showed a trend of increasing variations across the UK as one moves southwards, with London and Southampton at the higher side of the spectrum followed by Manchester which has the least variability amongst these three cities. This is the first study which investigates impact of the climate change on the UK supermarkets across different regions by using the real case scenarios.

**Keywords:** building simulation; climate change; energy performance; future weather; sustainability

### 1. Introduction

While the earth is experiencing a rapid climate change, the Intergovernmental Panel on Climate Change (IPCC) puts the human factor as the center of its reasoning, “there is a very high confidence that the globally averaged net effect of human activities since 1750 has been one of warming” (IPCC 2007). As a part of the research, this paper is going to focus on the global effort

---

\*Corresponding author, Professor, E-mail: ali.bahadori-jahromi@uwl.ac.uk

<sup>a</sup> M.Sc., E-mail: 21445082@student.uwl.ac.uk

to combat climate change relying on improving the energy efficiency of buildings in the coming decades (IEA 2006). This study investigates the impact of future climate change on the annual energy usage and carbon emissions of a typical supermarket across multiple different UK cities and will consider a standard baseline model of LIDL supermarket situated in London. An identical model is designed in Manchester and Southampton with their respective regional climates. A series of simulations were performed using building modelling software package (Thermal Analysis Software, TAS) by the CIBSE provided current and UKCP09 based future weather files. Also, dynamic hourly simulations of the building were performed in each location.

Commercial, retail, office and other building spaces like these are modelled using the TAS software and have been constructed and thoroughly validated by several researchers (Amoako-Attah and B-Jahromi 2013, 2014, Lykartsis *et al.* 2017, Bahadori-Jahromi *et al.* 2018). The local weather surrounding any building dictates the energy needs of the building (Ciancio *et al.* 2018). It can thus be inferred that the regional and local weather patterns will dictate the energy usage and subsequently, the carbon emissions for the existing buildings in the area (Andrić *et al.* 2017). These buildings, due to their local weather conditions will also dictate the change in their local civil building sector to keep the energy demand low (Zhai and Helman 2019). Fig. 1 shows how climate change not only affects, but also influences a buildings indoor weather condition which needs to be kept at an ambient range to ensure the optimum comfort of the occupants.

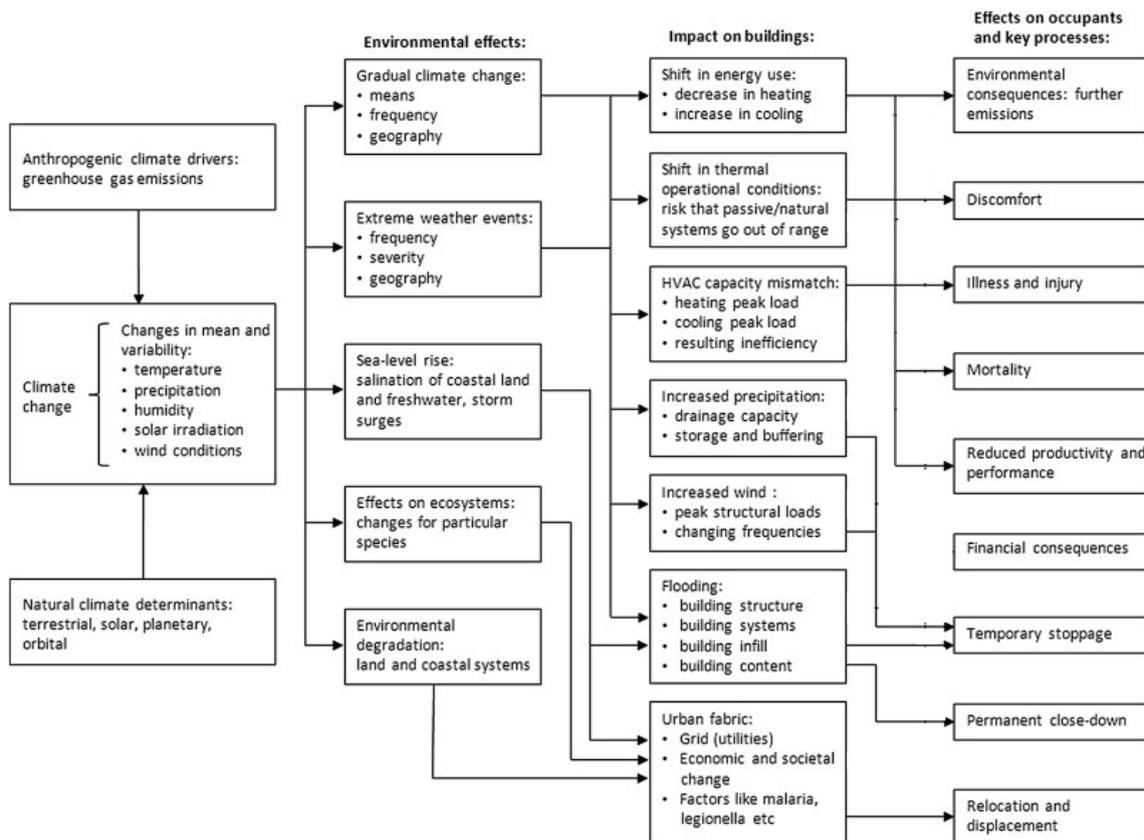


Fig. 1 Schematic summary of climate change effect on built environment (McMichael *et al.* 2006)

*Comparing building performance of supermarkets under future climate change*

According to one report, UK has over 87,000 supermarkets currently operational across the country (Retail foods, USDA 2019). The UK building sector accounts for approximately 3% of total electricity use and the UK supermarkets and similar organizations are responsible for 1% of the entire UK GHG emissions (Tassou *et al.* 2011). These are described as high energy use intensity (EUI) buildings due to their increased refrigeration and lighting needs.

Several researchers have investigated the effect of regional geographical climate on the energy consumption and carbon emissions on the supermarkets in the area. A considerable proportion of the buildings in the UK already perform quite poorly during the hot weather waves, reinforcing the need of an appropriate climate change future weather files to study the buildings performance assessment at regular time intervals (Nicol and Humphreys 2007).

In the UK, an example of a probabilistic approach of climate file for the future weather conditions was created by Kershaw *et al.* (2011) which was then validated for Plymouth (UK) known as 'PROMETHEUS' weather files based on the UKCP09 projections.

Fig. 2 gives a geographical view of the various research carried throughout the globe by academics to quantify and mitigate the effect of climate change. It includes places such as Europe, South Europe, Lithuania, Netherlands, Northern China, Hong Kong, Middle East. (Cellura *et al.* 2018, Pathan *et al.* 2017, Sabunas and Kanapickas 2017, Kočí *et al.* 2019, Hamdy *et al.* 2017, Dadoo and Gustavsson 2016, Shibuya and Croxford 2016, Wan *et al.* 2012, Farah *et al.* 2019, Roshan *et al.* 2019, Petri and Caldeira 2015). The world map is shown with the same colour representing that research regarding climate change is being carried out in these particular countries and how to mitigate its effects.

Despite all the studies available regarding the energy and carbon emissions of buildings worldwide, not enough data is available for UK after the creation of the UK Climate Projections (UKCP09). Although the effect of climate change on energy and carbon emissions in different building types has been investigated for various locations in the UK and around the world, no such investigation has been performed for supermarkets located in the climatic regions in Great Britain (Braun *et al.* 2016).



Fig. 2 World map showing climate change effect on buildings' performance (Ciancio *et al.* 2020)

## 2. Methodology

### 2.1 Thermal Analysis Simulation (TAS-EDSL) 3D modelling

One of the most critical steps in the methodology was to choose a simulation platform that can produce a dynamic model and can use the weather files. TAS-EDSL use individual calculations with several underlying software products and data exporting capability (Crawley *et al.* 2008). It is also in compliance checking for the building regulations guidance 2010: Part L2 for England and Wales (Pan and Garmston 2012) and comes integrated with the Building Research Establishment (BRE) software tool ‘Simplified Building Energy Model’ (SBEM) for analysis of building energy consumption (SBEM BRE 2020). TAS also provides the opportunity to combine the dynamic thermal simulation of the building with control functions over natural and mixed-mode ventilation (Bahadori-Jahromi *et al.* 2017).

### 2.2 Weather files used in simulation packages

A common feature present in all the software packages is the use of weather files used in building performance simulations are based on specific locations. Conventionally, the weather files used are in the form of hourly datasets and available in various formats depending on their geographical location.

CIBSE has taken an approach of producing two different simulation weather data sets, Test Reference Year (TRY) files for energy assessments and Design Summer Year (DSY) files for overheating analysis (CIBSE 2002). Since 2006, TRY and DSY are available for 14 sites throughout the UK using improved selection algorithms (Levermore and Parkinson 2006). The current TRY and DSY were morphed to incorporate the UKCP09 climate change scenarios of the time periods and the emission scenarios to limit any uncertainties that could affect the weather data (Eames *et al.* 2010). The future weather files are representative of the carbon emission scenarios of a low, medium, and high with varying levels of probabilities of 10th, 50th, and 90th percentiles and for three future timelines 2020s, 2050s and 2080s (Virk *et al.* 2015).

### 2.3 City selection criteria

The cities were selected after careful consideration, keeping in mind the regional climates in the UK. The chosen cities were in different regional climates to have a valid comparative view of the changing climate. UK has eleven regional climates based on different climatic characteristics such as temperature, sunshine, rainfall, snowfall, and wind (UK regional climates, 2021). These regions are:

- Scotland (Northern, Eastern, Western)
- Northern Ireland
- Wales
- Midlands
- England (North West & Isle of Man, North East, Eastern, Southern, South West)


Out of these regional climates, a cross over table was made with CIBSE provided ‘current’ and ‘future’ weather files which are presented in Table 1.

A variety of selected cities gives an invaluable insight into the future and direct effect of climate change as they have significantly different climatic characteristics and in turn shows how drastically the key performance indicators can change in the coming years due to climate change.


*Comparing building performance of supermarkets under future climate change*

Table 1 England regional climates and selected cities


| UK regional climate                | City selected |
|------------------------------------|---------------|
| North-West England & Isle of Man   | Manchester    |
| Southern England                   | Southampton   |
| England South-East & Central South | London        |

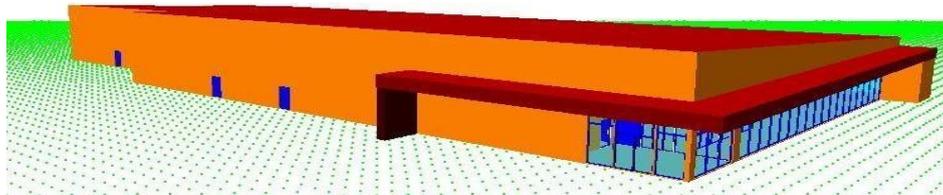


(a) Front view

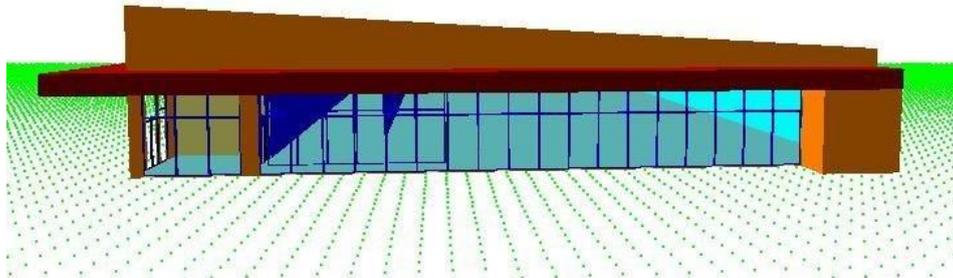

(b) Side view

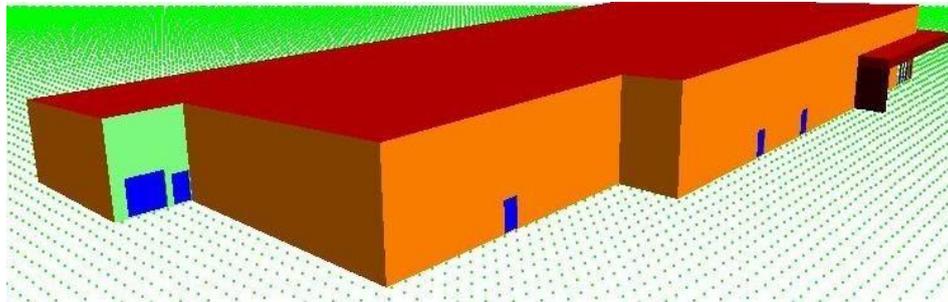

(c) 3D view

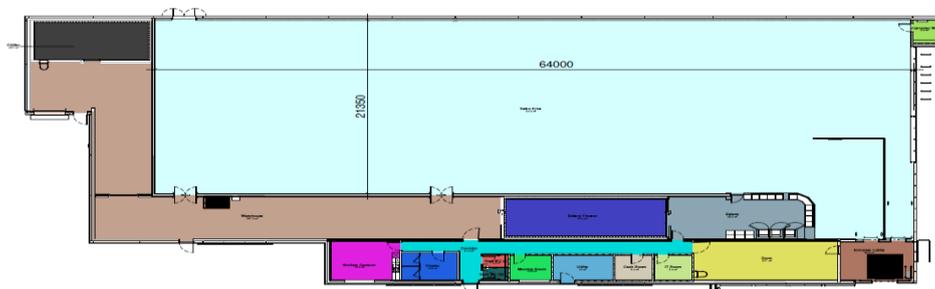

(d) Floor plan

Fig. 3 3D Supermarket

### 2.4 3D modelling

This is a real case purpose-built UK supermarket, and all the building data has been obtained by surveying and reviewing the building design documents to make sure the model represents the true scenario.

Figs. 3(a)-(d) show the 3-D drawings and the floor plan of the building along with its dimensions. The peak height of the supermarket store is 7.02 meter with a declining angle of 3.30° finishing at 5.104 meter. The entrance door is 5-meter-wide and 2.9-meter-tall in total. The rear elevation has a height of 4.635 meter tall. The curtain walling has double glazed units and is divided into upper and lower windows.

### 3. Modelling process

The architecture of building design in the software provides detailed measurements for the height and size of various compartments and sections of a typical UK supermarket with a floor area of 2,500 m<sup>2</sup>

The construction materials are assigned individually to each of the elements used in building construction and are tailored to the specifications of a typical supermarket; the internal conditions are also explicitly applied according to the individual zones and to be certain that these conditions adhere to the National Calculation Methodology (NCM). TRY files are used to predict average energy consumption and compliance with the UK building regulations (Eames et al. 2015).

#### 3.1 Simulation process

The simulation process starts with choosing with specific building and its local climate. After

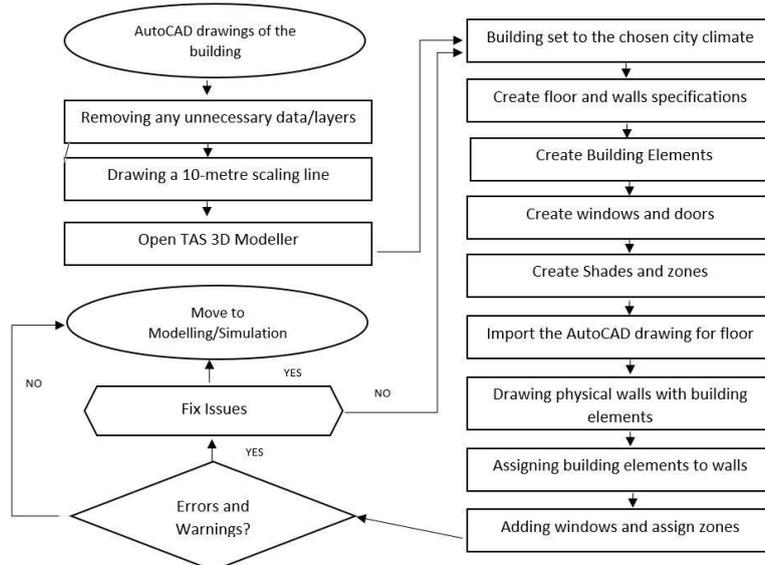


Fig. 4 Research flow plan: preparation to pre-modelling stage

## Comparing building performance of supermarkets under future climate change

Table 2 Simulation assumptions: building specification

| Building element          | Calculated area-weighted average U-values (W/m <sup>2</sup> K) |
|---------------------------|--|
| Wall                      | 0.24   |
| Floor                     | 0.21   |
| Roof                      | 0.13   |
| Windows                   | 3.08   |
| Personnel doors           | 1.32   |
| Vehicle access doors      | 1.78   |
| High usage entrance doors | 3.34   |

Table 3 Simulation assumptions: building summary specification

| Calendar               | NCM standard                                |
|------------------------|---|
| Air permeability       | 5.0 m <sup>3</sup> /h.m <sup>2</sup> @ 50Pa |
| Infiltration           | 0.125 (ACH)                                 |
| Fuel source            | Grid supplied electricity                   |
| CO <sub>2</sub> factor | 0.519 kg/kWh                                |

modelling the basics of the building such as floor, walls, windows and doors, it is important to import the computer aided design of the building. Next step is to draw the physical walls, assigning building elements and adding any further windows and zones. Final step is to run the simulation and check for any error, if there are any issues fix those and run the final modelling file.

To eliminate any errors, the TAS modeler undergoes a range of performance parameters and assumptions including the building summary, calendar year, weather database, building elements, zones, internal conditions, and schedules to simulate the building properly. Fig. 4 shows a flowchart representing the multiple stages in the supermarket building model from the AutoCAD drawings. The Tables 2-4 shows information relating to the supermarket building which is same in all three locations. However, due to their different geographical locations, their local weather data is supplied separately by The Chartered Institution of Building Services Engineers (CIBSE).

Table 2 shows a summary of simulation assumptions regarding the fabric specification modelled in the software. Similarly, Table 3 shows the building summary specification whereas Table 4 shows the thermophysical characteristics of the building materials.

### 3.2 UK Climate Projections (UKCP) Projections

For the UK-based buildings, a very accurate climate projection is provided by UK Climate Projections (UKCP). These were used to produce the future test reference years (TRY) that are available in three emission scenarios including high, medium, and low, with more details referred to in the paper (Hasan *et al.* 2020).

### 3.3 Current weather files

The current climate weather data includes the data of a specific geographical location resulting

Table 4 Construction details: specifications of thermophysical characteristics

| Type  |                               | Conductance<br>(W/m <sup>2</sup> . °C) | Solar             |                   | Emissivity | Construction<br>type |
|-------|-------------------------------|--|-------------------|-------------------|------------|----------------------|
|       |                               |  | absorptance       |                   |            |                      |
|       |                               |  | External/Internal | External/Internal |            |                      |
| Wall  | Cast concrete wall            | 0.974                                  | 0.700             |                   | 0.900      | Opaque               |
|       | Cavity wall                   | 0.25                                   | 0.700             |                   | 0.900      | Opaque               |
|       | Curtain wall                  | 5.227                                  | 0.700             |                   | 0.900      | Opaque               |
|       | Metal cladding wall           | 0.235                                  | 0.700             |                   | 0.900      | Opaque               |
|       | Steel frame wall              | 0.379                                  | 0.700             |                   | 0.900      | Opaque               |
| Frame | Uncoated glass, air-filled    | 5.545                                  | 0.101             | 0.078             | 0.840      | Transparent          |
|       | Metal, thermal break & spacer | 59.116                                 | 0.00              |                   | 0.850      | Transparent          |
|       | Wood, thermal spacer          | 7.89                                   | 0.00              |                   | 0.850      | Transparent          |
| Floor | Ground floor                  | 0.218                                  | 0.700             |                   | 0.900      | Opaque               |
| Door  | Insulated personal door       | 0.94                                   | 0.700             |                   | 0.900      | Opaque               |
|       | Vehicle door                  | 2.0                                    | 0.700             |                   | 0.900      | Opaque               |

from hourly Met Office observation as a meteorological service usually in areas adjacent to the location. It is described as consisting of months selected from individual years and concatenated to form a complete year (Renné 2016).

### 3.4 Future weather files

The CIBSE institute produced climate change weather files for 2020s, 2050s and 2080s for 14 locations in UK.

The Future weather files are created using a "morphing" procedure as explained earlier in the paper (Mavrogianni *et al.* 2011).

### 3.5 Data collection

As a part of data collection, the following information was gathered:

- EPC certificates
- Annual energy usage by calculating the grid-supplied electricity (kWh)
- Annual GHG emissions

Since the baseline supermarket model is designed as the 'standardized' LIDL supermarket building, it is assumed that the baseline model in all the chosen cities is identical. A data collection phase is shown below as a part of the flowchart in Fig. 5.

The subheadings 3.2 to 3.5 shows the UKCP, current and future weather files and data collection for each of the three locations. The simulation methodology is the same for all the locations. However, the weather data and the data collection depend on the geographical locations of the supermarket stores.

*Comparing building performance of supermarkets under future climate change*

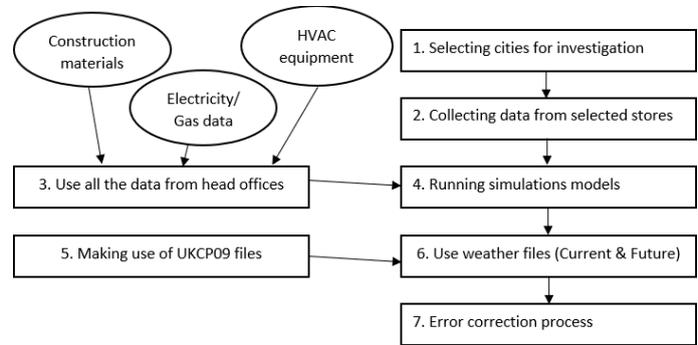


Fig. 5 Research flow plan: supermarkets investigation

**4. Results**

*4.1 London model*

As a common practice with all 3-D modelling, a baseline model was created, tested, and validated against the actual building of LIDL in London under the current conditions. The readings from TAS software provided a detailed account of heating, cooling, Domestic Hot Water (DHW), lighting, equipment, and auxiliary energy consumption.

*4.1.1 Current weather scenario*

Annual energy consumption in kWh/m<sup>2</sup> and CO<sub>2</sub> emissions breakdown in kg/m<sup>2</sup> of the baseline building modelled in London is shown in Fig. 6. This scenario is under the current weather conditions.

Lighting uses up the most energy due to the huge retail space including a warehouse, sales floor area and the use of lights in every office, changing room, canteen and toilets with cooling being the second highest energy consumption area as it includes the refrigeration, cooling cabinets and freezers and chillers. Similarly, the associated annual CO<sub>2</sub> emissions represent the biggest emissions sector to be lighting with cooling being the second one. The total annual energy is 112.33 kWh/m<sup>2</sup>, out of which lighting consumes 54.68% and cooling consumes 30.05% of the

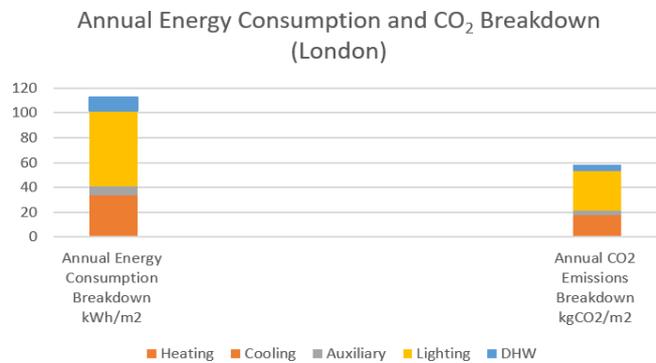


Fig. 6 Annual Energy Consumption and CO<sub>2</sub> breakdown

total energy consumption whereas the annual carbon emissions are 58.30 kgCO<sub>2</sub>/m<sup>2</sup>. For comparison purposes, a four-bedroom detached house located in Berkshire, England with poor insulation and a high demand of space heating/cooling demand can have an annual energy consumption of 135 kWh/m<sup>2</sup> and an annual carbon emission of 51.73 kgCO<sub>2</sub>/m<sup>2</sup> (Bahadori-Jahromi *et al.* 2018). Similarly, a four-story hotel in Watford, Hertfordshire with 10,000 m<sup>2</sup> floor area have an annual energy consumption of 260 kWh/m<sup>2</sup> and an annual carbon emission of 89.27 kgCO<sub>2</sub>/m<sup>2</sup> (Amirkhani *et al.* 2020). By these standards, depending on the floor area, when it comes to total energy consumption in the UK, the industrial area leads in energy consumption followed by residential areas and then the commercial industry.

#### 4.1.2 Future weather scenarios and Energy & CO<sub>2</sub> emissions

Multiple simulations were run with six and nine different emissions scenarios of low, medium, and high emission percentile under the periods 2050s and 2080s. Fig. 7 shows the annual energy and carbon dioxide consumption for future climatic projections for all the 2050s and 2080s scenarios. All the predicted scenarios show that there is a constant gradual increase in energy

For energy consumption, there is a peak increase of 3.66% in the 2050s medium (90th) percentile scenario and a 9.58% increase in the 2080s high (90th) percentile scenario, respectively.

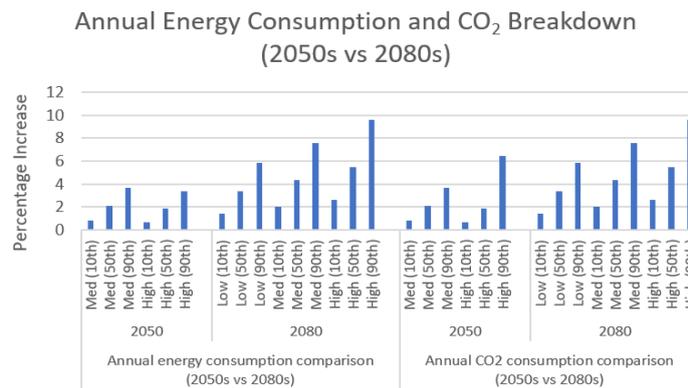


Fig. 7 Annual energy and CO<sub>2</sub> consumption comparison (2050s vs 2080s)

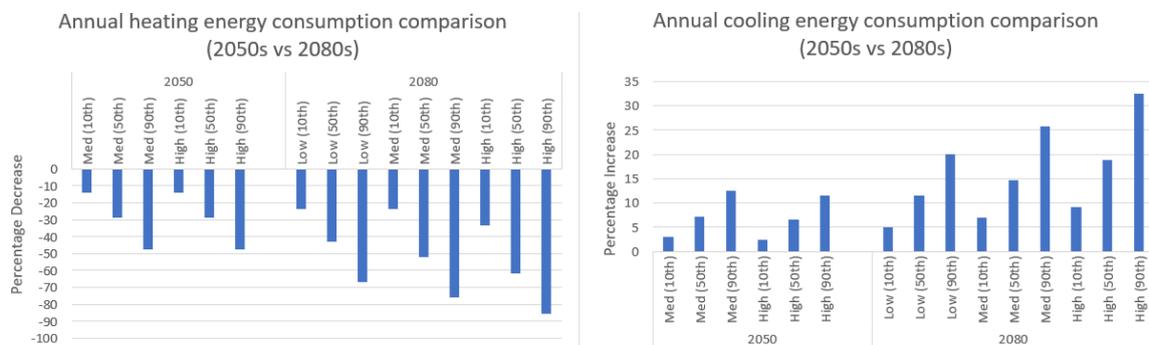


Fig. 8 (a) Annual heating energy consumption (2050s vs 2080s); (b) Annual cooling energy consumption (2050s vs 2080s)

### Comparing building performance of supermarkets under future climate change

For carbon emissions, there is a peak increase of 3.65% in the 2050s medium (90th) percentile scenario and a 9.59% increase in the 2080s high (90th) percentile scenario, respectively.

The increased consumption over the years is attributed to the increased cooling demand in the face of increasing temperatures.

#### 4.1.3 Heating & Cooling comparison

Figs. 8(a)-(b) shows the annual heating and cooling energy comparison for future climate projections for all the 2050s and 2080s scenarios. All the predicted heating energy scenarios show a constant gradual decrease in heating energy over the years, irrespective of any scenario or percentile chosen, whereas the cooling energy increases regardless of any scenario chosen.

For heating energy, there is a peak reduction of 47.62% in the 2050s medium (90th) percentile/high (90th) percentile scenario and an 85.72% reduction in the 2080s high (90th) percentile scenario, respectively. It confirms a gradual increase in the temperature over time. Over the years, the reduced heating consumption is attributed to the increase in temperature influencing the heating demand to be reduced.

For cooling energy, there is a peak increase of 12.47% in the 2050s medium (90th) percentile scenario and a 32.41% increase in the 2080s high (90th) percentile scenario, respectively. This rise in the annual cooling energy consumption confirms a gradual increase in the temperature over time. Over the years, the increased cooling consumption is attributed to the increasing external temperature, thus increasing the need for cooling in the supermarket building.

### 4.3 Manchester Model

#### 4.3.1 Current weather scenario

Annual energy consumption and CO<sub>2</sub> emissions breakdown of the baseline building modelled in Manchester is presented in Fig. 9.

The total annual energy for the current weather scenario for a typical supermarket building in Manchester comes up to be 109.45 kWh/m<sup>2</sup>. The emissions are 56.81 kgCO<sub>2</sub>/m<sup>2</sup> with heating and cooling at 0.14 and 15.99 kWh/m<sup>2</sup> respectively.

#### 4.3.2 Future weather scenario and Energy & CO<sub>2</sub> emissions

There are six and nine different emissions scenarios under the years the 2050s and 2080s

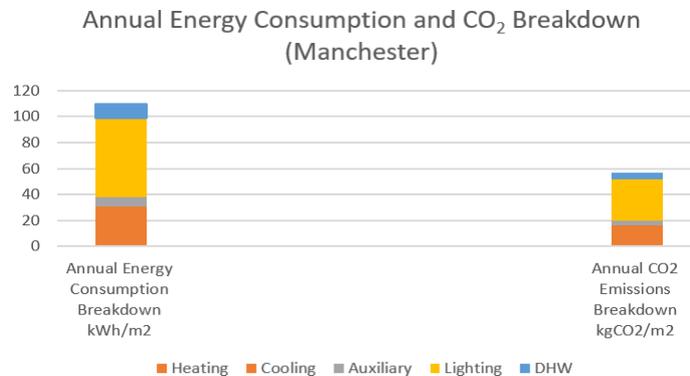


Fig. 9 Annual energy consumption and CO<sub>2</sub> breakdown

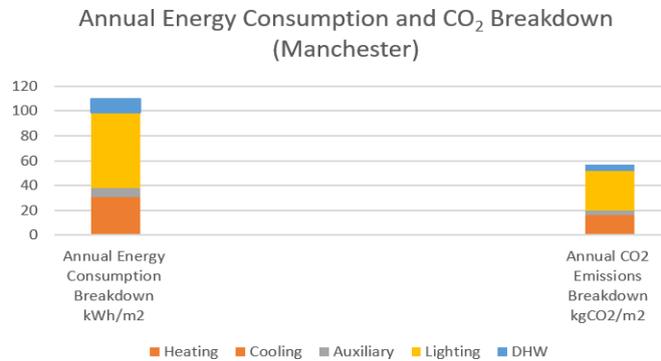


Fig. 9 Annual energy consumption and CO<sub>2</sub> breakdown

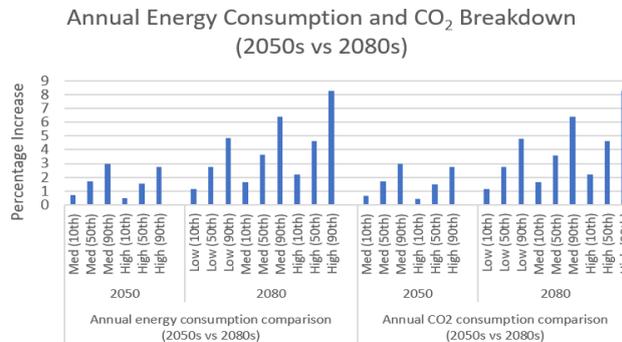


Fig. 10 Annual energy and CO<sub>2</sub> consumption comparison (2050s vs 2080s)

respectively. A total of 130 simulations were run and validated against the actual data and then further mathematical calculations were made to determine the percentage increase/decrease for the key performance indicators. Fig. 10 shows the annual energy and carbon dioxide consumption for future climatic projections for all the 2050s and 2080s scenarios. All the predicted scenarios show a constant gradual increase in energy consumption over the years, irrespective of any scenario or percentile chosen.

For energy consumption, there is a peak increase of 3.00% in the 2050s medium (90th) percentile scenario and an 8.30% increase in the 2080s high (90th) percentile scenario, respectively.

For carbon emissions, there is a peak increase of 2.99% in the 2050s medium (90th) percentile scenario and an 8.29% increase in the 2080s high (90th) percentile scenario, respectively. The increased consumption over the years is attributed to the increased cooling demand in the face of increasing climatic temperature.

#### 4.2.3 Heating & Cooling comparison

Figs. 11(a)-(b) shows the annual heating and cooling energy comparison for future climatic projections for all the 2050s and 2080s scenarios.

All the predicted scenarios of heating energy show that there is a constant gradual decrease in heating energy over the years, irrespective of any scenario or percentile chosen whereas, the

### Comparing building performance of supermarkets under future climate change

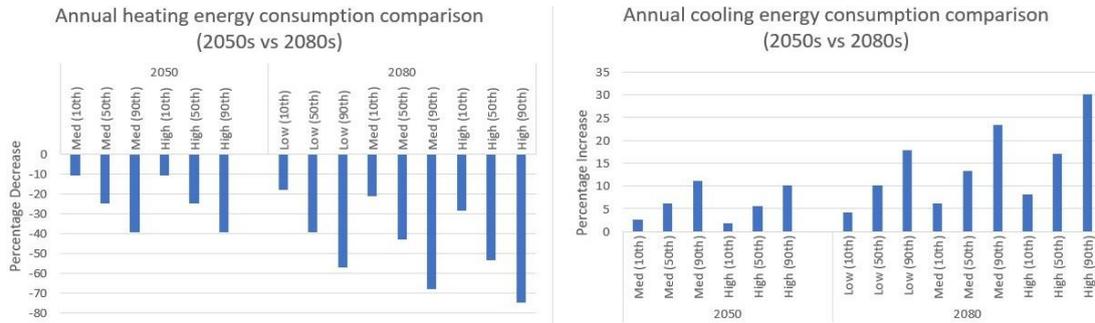


Fig. 11 (a) Annual heating energy consumption (2050s vs 2080s); (b) Annual cooling energy consumption (2050s vs 2080s)

cooling energy increases irrespective of any scenario chose.

For heating energy, there is a peak reduction of 39.29% in the 2050s medium (90th) percentile/high (90th) percentile scenario and a 39.29% reduction in the 2080s high (90th) percentile scenario, respectively. Over the years, the reduced heating consumption is attributed to the increase in climatic temperature influencing the heating demand to be minimized.

For cooling energy, there is a peak increase of 11.00% in the 2050s medium (90th) percentile scenario and a 30.11% increase in the 2080s high (90th) percentile scenario, respectively. Over the years, the increased cooling consumption is attributed to the increasing external temperature, thus increasing the need for cooling in the supermarket building.

### 4.3 Southampton model

#### 4.3.1 Current weather scenario

Annual energy consumption and CO<sub>2</sub> emissions breakdown of the baseline building modelled in Southampton is presented in Fig. 12.

The total annual energy for the current weather scenario for a typical supermarket building in Southampton comes up to be 111.63 kWh/m<sup>2</sup> whereas, the emissions are 57.94 kgCO<sub>2</sub>/m<sup>2</sup> with heating and cooling at 0.12 and 17.15 kWh/m<sup>2</sup> respectively.

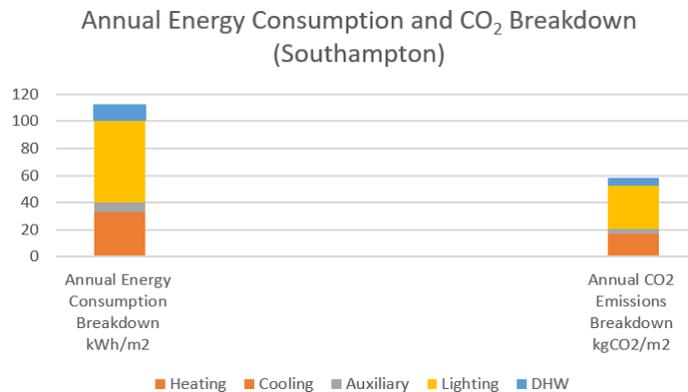


Fig. 12 Annual energy consumption and CO<sub>2</sub> breakdown

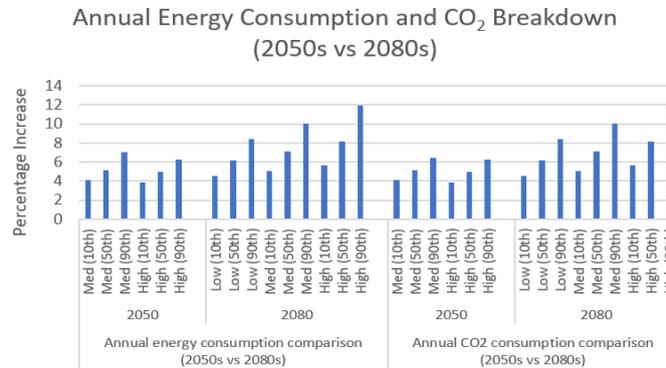


Fig. 13 Annual energy and CO<sub>2</sub> consumption comparison (2050s vs 2080s)

#### 4.3.2 Future weather scenarios

Under the years 2050 and 2080s, there is an array of different emission scenarios. Six emission scenarios from 2050s and then nine from 2080s help to find out the percentage increase/decrease for the key performance indicators.

#### 4.3.3 Energy & CO<sub>2</sub> emissions

Fig. 13 shows the annual energy and CO<sub>2</sub> consumption for future climatic projections for all the 2050s and 2080s scenarios. A constant increase in the energy consumption is documented in every scenario of any year.

For energy consumption, there is a peak increase of 3.73% in the 2050s medium (90th) percentile scenario and a 10.04% increase in the 2080s high (90th) percentile scenario, respectively. For carbon emissions, there is a peak increase of 3.72% in the 2050s medium (90th) percentile scenario and a 10.02% increase in the 2080s high (90th) percentile scenario, respectively. The increased consumption over the years is attributed to the increased cooling demand in the face of increasing climatic temperature.

#### 4.3.4 Heating & Cooling comparison

All the predicted scenarios of heating energy show that there is a constant gradual decrease in

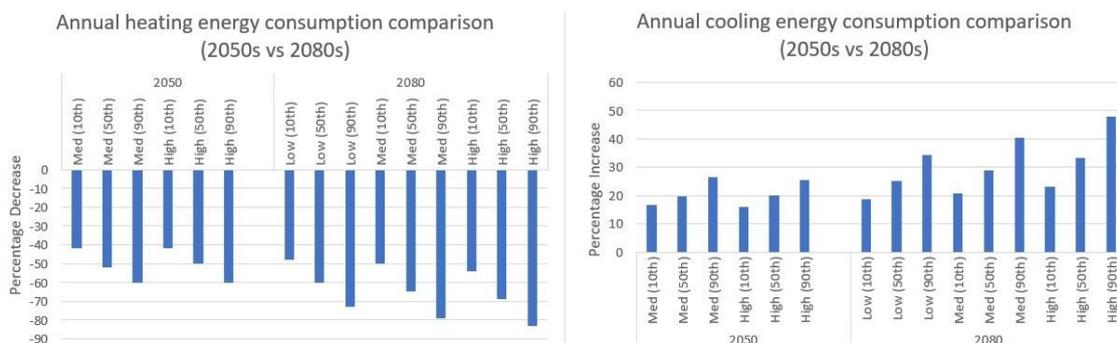


Fig. 14 (a) Annual heating energy consumption (2050s vs 2080s); (b) Annual cooling energy consumption (2050s vs 2080s)

*Comparing building performance of supermarkets under future climate change*

heating energy over the years, irrespective of any scenario or percentile chosen whereas, the cooling energy increases regardless of any scenario chosen. Figs. 14(a)-(b) shows the annual heating and cooling energy comparison for future climatic projections for all the 2050s and 2080s scenarios.

For heating energy, there is a peak reduction of 40.91% in the 2050s medium (90th) percentile/high (90th) percentile scenario and a 72.72% reduction in the 2080s high (90th) percentile scenario, respectively. Over the years, the reduced heating consumption is attributed to the increase in climatic temperature, influencing the heating demand to be minimized.

For cooling energy, there is a peak increase of 12.91% in the 2050s medium (90th) percentile scenario and a 34.43% increase in the 2080s high (90th) percentile scenario, respectively. This rise in the annual cooling energy consumption shows a gradual increase in the temperature over time.

#### *4.4 Full multi-city comparative analysis*

Tables 5(a)-(d) presents all the data of key performance indicators of a typical supermarket building for London, Manchester, and Southampton.

Those includes the annual energy consumption, annual carbon emissions, heating, and cooling energy consumption for the future years of the 2050s and 2080s for the emission scenarios of low, medium, high and of 10th, 50th and 90th percentile, respectively between various cities. It also helps distinguishes the best- and worst-case scenario among all possible outcomes.

All the predicted scenarios show that there is a constant decrease in heating consumption over the years and all the predicted scenarios show a constant increase in cooling consumption over

Table 5(a) Multi-city annual heating and cooling consumption (all emissions scenarios)

| Annual heating consumption | London | Manchester | Southampton |
|----------------------------|--------|------------|-------------|
| 2050s                      |        |            |             |
| Med 10                     | -14.29 | -10.71     | -9.09       |
| Med 50                     | -28.57 | -25.00     | -27.27      |
| Med 90                     | -47.62 | -39.29     | -40.91      |
| High 10                    | -14.29 | -10.71     | -9.09       |
| High 50                    | -28.57 | -25.00     | -27.27      |
| High 90                    | -47.62 | -39.29     | -40.91      |
| 2080s                      |        |            |             |
| Low 10                     | -23.81 | -17.86     | -18.18      |
| Low 50                     | -42.86 | -39.29     | -40.91      |
| Low 90                     | -66.67 | -57.14     | -59.09      |
| Med 10                     | -23.81 | -21.43     | -22.72      |
| Med 50                     | -52.38 | -42.86     | -45.45      |
| Med 90                     | -76.19 | -67.86     | -68.18      |
| High 10                    | -33.33 | -28.57     | -31.81      |
| High 50                    | -61.90 | -53.57     | -54.54      |
| High 90                    | -85.71 | -75.00     | -72.72      |

Table 5(a) Continued

| Annual heating consumption | London | Manchester | Southampton |
|----------------------------|--------|------------|-------------|
| 2050s                      |        |            |             |
| Med 10                     | 2.93   | 2.5        | 3.14        |
| Med 50                     | 7.14   | 6.23       | 7.35        |
| Med 90                     | 12.47  | 11.00      | 12.91       |
| High 10                    | 2.31   | 1.72       | 2.32        |
| High 50                    | 6.58   | 5.58       | 6.53        |
| High 90                    | 11.46  | 10.16      | 11.61       |
| 2080s                      |        |            |             |
| Low 10                     | 4.98   | 4.15       | 5.44        |
| Low 50                     | 11.52  | 10.03      | 11.95       |
| Low 90                     | 20.02  | 17.85      | 20.93       |
| Med 10                     | 6.93   | 6.07       | 7.59        |
| Med 50                     | 14.75  | 13.21      | 15.73       |
| Med 90                     | 25.65  | 23.36      | 27.08       |
| High 10                    | 9.06   | 8.05       | 10.16       |
| High 50                    | 18.72  | 16.97      | 20.09       |
| High 90                    | 32.41  | 30.11      | 34.43       |

the years (Table 5(a)), irrespective of any scenario or percentile chosen.

This increase in cooling requirements can be attributed to the long summers and extreme summer heat waves, which can be due to increasing annual average temperature whereas the large decline in heating requirement points out to a rapid increase in temperatures in the future across the UK.

Table 5(b) shows all the predicted scenarios show a constant increase over the years. This increase in energy demand can be attributed to the due to the burden on cooling requirements.

Table 5(b) Multi-city annual total energy consumption (all emissions scenarios)

| Annual total energy consumption | London | Manchester | Southampton |
|---------------------------------|--------|------------|-------------|
| 2050s                           |        |            |             |
| Med 10                          | 0.85   | 0.69       | 0.9         |
| Med 50                          | 2.08   | 1.7        | 2.12        |
| Med 90                          | 3.66   | 3.00       | 3.73        |
| High 10                         | 0.67   | 0.47       | 0.67        |
| High 50                         | 1.92   | 1.52       | 1.88        |
| High 90                         | 3.36   | 2.77       | 3.36        |

*Comparing building performance of supermarkets under future climate change*

Table 5(b) Continued

| Annual total energy consumption | London | Manchester | Southampton |
|---------------------------------|--------|------------|-------------|
| 2080s                           |        |            |             |
| Low 10                          | 1.45   | 1.13       | 1.56        |
| Low 50                          | 3.37   | 2.73       | 3.45        |
| Low 90                          | 5.89   | 4.88       | 6.08        |
| Med 10                          | 2.04   | 1.66       | 2.19        |
| Med 50                          | 4.34   | 3.62       | 4.57        |
| Med 90                          | 7.57   | 6.41       | 7.88        |
| High 10                         | 2.67   | 2.20       | 2.94        |
| High 50                         | 5.51   | 4.65       | 5.84        |
| High 90                         | 9.58   | 8.30       | 10.04       |

Table 5(c) Multi-city annual CO<sub>2</sub> emissions (all emissions scenarios)

| Annual carbon dioxide emissions | London | Manchester | Southampton |
|---------------------------------|--------|------------|-------------|
| 2050s                           |        |            |             |
| Med 10                          | 0.86   | 0.67       | 0.89        |
| Med 50                          | 2.09   | 1.69       | 2.12        |
| Med 90                          | 3.65   | 2.99       | 3.72        |
| High 10                         | 0.67   | 0.46       | 0.65        |
| High 50                         | 1.92   | 1.50       | 1.88        |
| High 90                         | 6.45   | 2.76       | 3.35        |
| 2080s                           |        |            |             |
| Low 10                          | 1.46   | 1.13       | 1.55        |
| Low 50                          | 3.38   | 2.73       | 3.45        |
| Low 90                          | 5.88   | 4.80       | 6.07        |
| Med 10                          | 2.04   | 1.65       | 2.19        |
| Med 50                          | 4.34   | 3.61       | 4.55        |
| Med 90                          | 7.56   | 6.41       | 7.87        |
| High 10                         | 2.66   | 2.20       | 2.93        |
| High 50                         | 5.51   | 4.63       | 5.83        |
| High 90                         | 9.59   | 8.29       | 10.02       |

## 5. Discussion

The study investigated the variability of future climatic conditions on a typical UK supermarket across three different cities – London, Manchester, and Southampton. The statistical analysis of simulation results concludes that the worst-case scenario (High 90) of 2080s would cause the most

damage to the supermarket industry where the Med 10 scenario of 2050s would cause a non-significant change. Similarly, the Low scenarios of 2080s help built a regression line value to understand the gradual to drastic increase in the energy and emissions and a declining trend in heating demand.

In terms of total energy consumption difference between current and future data sets, the peak percentage changes for the 2080s high (90th) percentile were 9.58%, 8.30% and 10.04% respectively for the three cities. The peak differences in emissions were found to be 9.59%, 8.29% and 10.02% for the 2080s high (90th) percentile for the three urban settlements, respectively. For cooling, these values were 32.41%, 30.11% and 34.43% for 2080s high (90th) percentile respectively. The differences in heating parameters for the 2080s high (90th) percentile turned out to be 85.71%, 75.00% and 72.72%.

The results clearly proclaim that the annual energy and carbon emissions increase drastically over the coming years specifically under the worst-case scenario and for the southern areas of UK. It requires attention to the supermarket's prioritized approach so that a pre-emptive action can counter these effects. In terms of operational carbon emissions, the most important design change of the building includes curbing the use of lighting as it is the biggest source of carbon emissions. A good recommendation would be increasing the use of passive lighting in stores, installation of the same and automation wherever possible. Additionally, lighting control and smart lighting can ensure that the energy consumption and associated emissions are reduced. Other energy efficiency measures include usage of efficient heating, cooling, ventilation and using equipment with higher coefficients of performance, usage of renewable and microgeneration technologies plus on-site low and zero (LZC) technologies. By making these changes in the most affected areas in UK, the supermarket buildings can tailor their needs and can reduce the impact of future climate change.

Such retrofit customizations must also keep in mind the utility of commercial infrastructure, like hotels where cooling and heating demands will occupy the primary considerations in energy consumption (Rotimi *et al.* 2018, Salem *et al.* 2019, Amirkhani *et al.* 2020).

## 6. Conclusions

This research enables the existing scientific inputs to amplify further the predictability and the implications of any construction-based endeavors undertaken in the future and promote effective, efficient, and responsive eco-friendly policies. It also enables the engineering community to understand the requirements for future-proof supermarket buildings. It would allow the decision-makers to adopt mitigation strategies to slow down the effects of climate change by tackling it beforehand, therefore building a more safe, resilient, and secure world for us all. Emerging renewable and microgeneration technologies can be utilized to adapt to climate change by infusing energy efficiency measures through enhanced effective planning and design options to generate a robust construction blueprint. HVAC systems, passive design technologies to mitigate mechanical ventilation, and better refrigerant usage with low environmental impact and excellent thermodynamic performance can be absorbed and integrated into supermarket architecture and energy designs to reduce the future energy demands in the supermarkets.

## References

Amirkhani, S., Bahadori-Jahromi, A., Mylona, A., Godfrey, P. and Cook, D. (2020), "Impact of adding

*Comparing building performance of supermarkets under future climate change*

- comfort cooling systems on the energy consumption and the EPC rating of an existing UK hotel”, *Sustainability*, **12**, 2950. <https://doi.org/10.3390/su12072950>
- Amoako-Attah, J. and B-Jahromi, A. (2013), “Impact of future climate change on UK building performance”, *Adv. Environ. Res., Int. J.*, **2**(3), 203-227. <https://doi.org/10.12989/aer.2013.2.3.203>
- Amoako-Attah, J. and B-Jahromi, A. (2014), “Impact of standard construction specification on thermal comfort in UK dwellings”, *Adv. Environ. Res., Int. J.*, **3**(3), 253-281. <https://doi.org/10.12989/aer.2014.3.3.253>
- Andrić, I., Pina, A., Ferrão, P., Fournier, J., Lacarrière, B. and Le Corre, O. (2017), “The impact of climate change on building heat demand in different climate types”, *Energy Build.*, **149**, 225-234. <https://doi.org/10.1016/j.enbuild.2017.05.047>
- Bahadori-Jahromi, A., Rotimi, A., Mylona, A., Godfrey, P. and Cook, D. (2017), “Impact of window films on the overall energy consumption of existing UK hotel buildings”, *Sustainability*, **9**(5), 731. <https://doi.org/10.3390/su9050731>
- Bahadori-Jahromi, A., Salem, R., Mylona, A., Godfrey, P. and Cook, D. (2018), “Retrofit of a UK residential property to achieve nearly zero energy building standard”, *Adv. Environ. Res., Int. J.*, **7**(1), 13-28. <https://doi.org/10.12989/aer.2018.7.1.028>
- Braun, M., Beck, S., Walton, P. and Mayfield, M. (2016), “Estimating the impact of climate change and local operational procedures on the energy use in several supermarkets throughout Great Britain”, *Energy Build.*, **111**, 109-119. <https://doi.org/10.1016/j.enbuild.2015.11.038>
- Burns, D. (1996), “Retailing: concepts, strategy, and implementation”, *J. Retail. Consumer Serv.*, **3**(3), 190-191. [https://doi.org/10.1016/0969-6989\(96\)86958-x](https://doi.org/10.1016/0969-6989(96)86958-x)
- Cellura, M., Guarino, F., Longo, S. and Tumminia, G. (2018), “Climate change and the building sector: modeling and energy implications to an office building in southern Europe”, *Energy Sustain. Develop.*, **45**, 46-65. <https://doi.org/10.1016/j.esd.2018.05.001>
- Ciancio, V., Falasca, S., Golasi, I., Curci, G., Coppi, M. and Salata, F. (2018), “Influence of input climatic data on simulations of annual energy needs of a building: energyplus and wrf modeling for a case study in Rome (Italy)”, *Energies.*, **11**(10), 2835. <https://doi.org/10.1016/j.scs.2020.102213>
- Ciancio, V., Salata, F., Falasca, S., Curci, G., Golasi, I. and de Wilde, P. (2020), “Energy demands of buildings in the framework of climate change: An investigation across Europe. Sustainable Cities and Society”, *Sustain Cities Soc.*, **60**, 102213. <https://doi.org/10.3390/en11102835>
- CIBSE (2002), Guide J: Weather, Solar and Illuminance data, London, U.K. <https://www.cibse.org/knowledge/knowledge-items/detail?id=a0q3Y00000Hj0hmQAB>
- Crawley, D., Hand, J., Kummert, M. and Griffith, B. (2008), “Contrasting the capabilities of building energy performance simulation programs”, *Build. Environ.*, **43**(4), 661-673. <https://doi.org/10.1016/j.buildenv.2006.10.027>
- Dodoo, A. and Gustavsson, L. (2016), “Energy use and overheating risk of Swedish multi-storey residential buildings under different climate scenarios”, *Energy*, **97**, 534-548. <https://doi.org/10.1016/j.energy.2015.12.086>
- Eames, M., Kershaw, T. and Coley, D. (2010), “On the creation of future probabilistic design weather years from UKCP09”, *Build. Serv. Eng. Res. Technol.*, **32**(2), 127-142. <https://doi.org/10.1177/0143624410379934>
- Eames, M., Ramallo-Gonzalez, A. and Wood, M. (2015), “An update of the UK’s test reference year: The implications of a revised climate on building design”, *Build. Serv. Eng. Res. Technol.*, **37**(3), 316-333. <https://doi.org/10.1177/0143624415605626>
- Farah, S., Whaley, D., Saman, W. and Boland, J. (2019), “Integrating climate change into meteorological weather data for building energy simulation”, *Energy Build.*, **183**, 749-760. <https://doi.org/10.1016/j.enbuild.2018.11.045>
- Hamdy, M., Carlucci, S., Hoes, P. and Hensen, J. (2017), “The impact of climate change on the overheating risk in dwellings—A Dutch case study”, *Build. Environ.*, **122**, 307-323. <https://doi.org/10.1016/j.buildenv.2017.06.031>
- Hasan, A., Bahadori-Jahromi, A., Mylona, A., Ferri, M. and Tahayori, H. (2020), “Investigating the potential impact of future climate change on UK supermarket building performance”, *Sustainability*, **13**(1), 33 <https://doi.org/10.3390/su13010033>
- IEA (2006), World Energy Outlook, Paris. <https://www.iea.org/reports/world-energy-outlook-2006>

- IPCC (2007), *Climate Change 2007: The Physical Science Basis*, London, U.K.  
<<https://www.ipcc.ch/report/ar4/wg1/>>
- Ji, Y., Lee, A. and Swan, W. (2019), “Building dynamic thermal model calibration using the energy house facility at Salford”, *Energy Build.*, **191**, 224-234. <https://doi.org/10.1016/j.enbuild.2019.03.001>
- Kershaw, T., Eames, M. and Coley, D. (2011), “Assessing the risk of climate change for buildings: a comparison between multi-year and probabilistic reference year simulations”, *Build. Environ.*, **46**(6), 1303-1308. <https://doi.org/10.1016/j.buildenv.2010.12.018>
- Kočí, J., Kočí, V., Maděra, J. and Černý, R. (2019), “Effect of applied weather data sets in simulation of building energy demands: comparison of design years with recent weather data”, *Renew. Sustain. Energy Rev.*, **100**, 22-32. <https://doi.org/10.1016/j.rser.2018.10.022>
- Levermore, G. and Parkinson, J. (2006), “Analyses and algorithms for new test reference years and design summer years for the UK”, *Build. Serv. Eng. Res. Technol.*, **27**(4), 311-325.  
<https://doi.org/10.1177/0143624406071037>
- Lykartsis, A., B-Jahromi, A. and Mylona, A. (2017), “Evaluation of thermal comfort and cooling loads for a multistory building”, *Adv. Environ. Res., Int. J.*, **5**(1), 65-77. <https://doi.org/10.12989/eri.2017.5.1.065>
- Mavrogianni, A., Davies, M., Batty, M., Belcher, S., Bohnenstengel, S., Carruthers, D., Chalabi, Z., Croxford, B., Demanuele, C., Evans, S., Giridharan, R., Hacker, J., Hamilton, I., Hogg, C., Hunt, J., Kolo kotroni, M., Martin, C., Milner, J., Rajapaksha, I., Ridley, I., Steadman, J., Stocker, J., Wilkinson, P. and Ye, Z. (2011), “The comfort, energy and health implications of London’s urban heat island”, *Build. Serv. Eng. Res. Technol.*, **32**(1), 35-52. <https://doi.org/10.1177/0143624410394530>
- McMichael, A., Woodruff, R. and Hales, S. (2006), “Climate change and human health: present and future risks”, *The Lancet*, **367**(9513), 859-869. [https://doi.org/10.1016/s0140-6736\(06\)68079-3](https://doi.org/10.1016/s0140-6736(06)68079-3)
- Met Office (2021), UK regional climates.  
<<https://www.metoffice.gov.uk/research/climate/maps-and-data/regional-climates/index>>
- Nicol, F. and Humphreys, M. (2007), “Maximum temperatures in European office buildings to avoid heat discomfort”, *Solar Energy*, **81**(3), 295-304. <https://doi.org/10.1016/j.solener.2006.07.007>
- Pan, W. and Garmston, H. (2012), “Building regulations in energy efficiency: Compliance in England and Wales”, *Energy Policy*, **45**, 594-605. <https://doi.org/10.1016/j.enpol.2012.03.010>
- Pathan, A., Mavrogianni, A., Summerfield, A., Oreszczyn, T. and Davies, M. (2017), “Monitoring summer indoor overheating in the London housing stock”, *Energy Build.*, **141**, 361-378.  
<https://doi.org/10.1016/j.enbuild.2017.02.049>
- Petri, Y. and Caldeira, K. (2015), “Impacts of global warming on residential heating and cooling degree-days in the United States”, *Scientif. Reports*, **5**(1). <https://doi.org/10.1038/srep12427>
- Renné, D. (2016), “Resource assessment and site selection for solar heating and cooling systems”, *Adv. Solar Heat. Cool.*, 13-41.
- Roshan, G., Oji, R. and Attia, S. (2019), “Projecting the impact of climate change on design recommendations for residential buildings in Iran”, *Build. Environ.*, **155**, 283-297.  
<https://doi.org/10.1016/j.buildenv.2019.03.053>
- Rotimi, A., Bahadori-Jahromi, A., Mylona, A., Godfrey, P. and Cook, D. (2018), “Optimum size selection of CHP retrofitting in existing UK hotel building”, *Sustainability*, **10**(2044).  
<https://doi.org/10.3390/su10062044>
- Sabunas, A. and Kanapickas, A. (2017), “Estimation of climate change impact on energy consumption in a residential building in Kaunas, Lithuania, using HEED Software”, *Energy Procedia*, **128**, 92-99.  
<https://doi.org/10.1016/j.egypro.2017.09.020>
- Salem, R., Bahadori-Jahromi, A., Mylona, A., Godfrey, P. and Cook, D. (2019), “Investigating the potential impact of energy efficient measures for retrofitting existing UK Hotels to reach the nearly zero energy building (nZEB) standard”, *Energy Efficiency*, **12**, 1577-1594. <https://doi.org/10.1007/s12053-019-09801-2>
- SBEM BRE (2020), National Calculation Method, Watford. <<http://www.ncm.bre.co.uk>>
- Shibuya, T. and Croxford, B. (2016), “The effect of climate change on office building energy consumption in Japan”, *Energy Build.*, **117**, 149-159. <https://doi.org/10.1016/j.enbuild.2016.02.023>
- TAS EDSL (2021), <<http://www.edsl.net/main/Support/Documentation.aspx>>

*Comparing building performance of supermarkets under future climate change*

- Tassou, S., Ge, Y., Hadawey, A. and Marriott, D. (2011), “Energy consumption and conservation in food retailing”, *Appl. Thermal Eng.*, **31**(2-3), 147-156. <https://doi.org/10.1016/j.applthermaleng.2010.08.023>
- USDA United States Department of Agriculture (2019), Retail food report, U.S. <<https://apps.fas.usda.gov/newgainapi/api/report>>
- Virk, G., Mylona, A., Mavrogianni, A. and Davies, M. (2015), “Using the new CIBSE design summer years to assess overheating in London: effect of the urban heat island on design”, *Build. Serv. Eng. Res. Technol.*, **36**(2), 115-128. <https://doi.org/10.1177/0143624414566247>
- Wan, K., Li, D., Pan, W. and Lam, J. (2012), “Impact of climate change on building energy use in different climate zones and mitigation and adaptation implications”, *Appl. Energy*, **97**, 274-282. <https://doi.org/10.1016/j.apenergy.2011.11.048>
- Zhai, Z. and Helman, J. (2019), “Implications of climate changes to building energy and Design”, *Sustain. Cities Soc.*, **44**, 511-519. <https://doi.org/10.1016/j.scs.2018>

CC